


Irradiated RBC and Platelets

The Type and Cross order was updated with the 19.2 Go live in October 2019. A special requirements section was added to better indicate when a patient needed a special requirement such as irradiated.

Try It Out

- When ordering Irradiated RBCs, click the Special Requirements. It will pull in Irradiated.
Note: by selecting **Save as patient's Requirements** this will cross encounters.

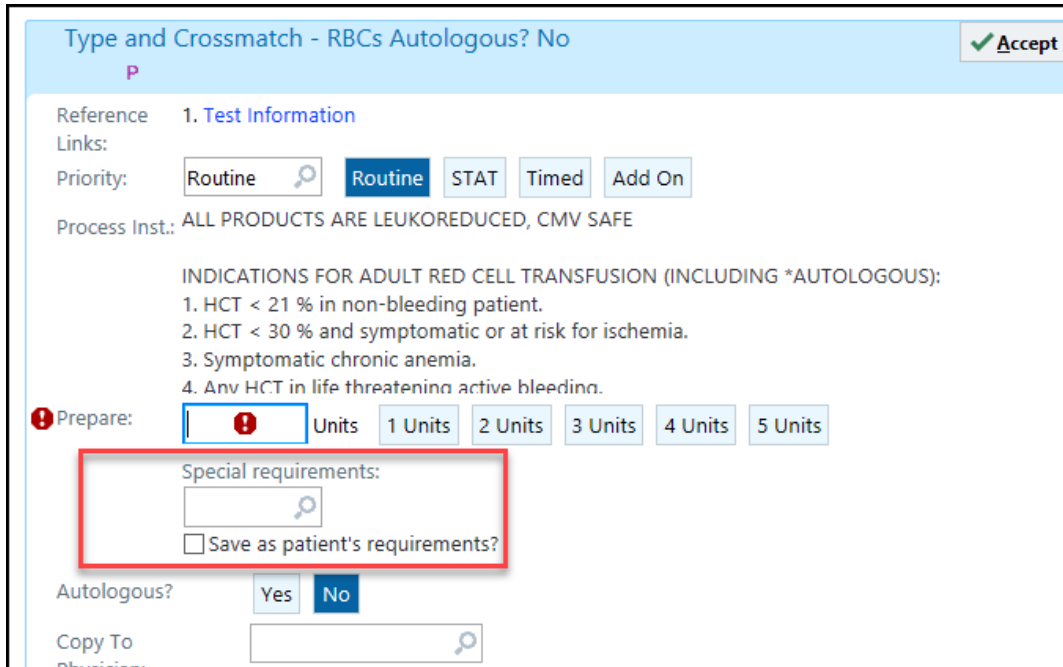

Type and Crossmatch - RBCs Autologous? No ✔ Accept

P

Reference 1. Test Information

Links:

Priority:

Process Inst.: ALL PRODUCTS ARE LEUKOREduced, CMV SAFE

INDICATIONS FOR ADULT RED CELL TRANSFUSION (INCLUDING *AUTOLOGOUS):

- HCT < 21 % in non-bleeding patient.
- HCT < 30 % and symptomatic or at risk for ischemia.
- Symptomatic chronic anemia.
- Anv HCT in life threatening active bleeding.

Prepare:


Special requirements:

Save as patient's requirements?

Autologous?

Copy To

Physician:

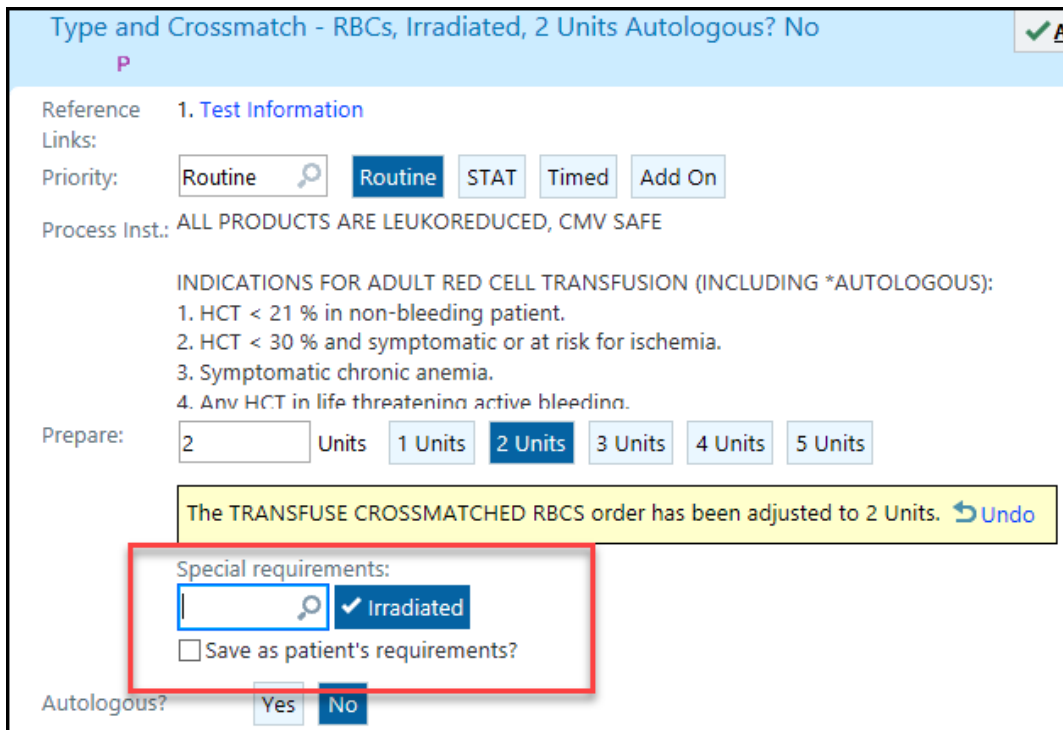

Type and Crossmatch - RBCs, Irradiated, 2 Units Autologous? No ✔ Accept

P

Reference 1. Test Information

Links:

Priority:

Process Inst.: ALL PRODUCTS ARE LEUKOREduced, CMV SAFE

INDICATIONS FOR ADULT RED CELL TRANSFUSION (INCLUDING *AUTOLOGOUS):

- HCT < 21 % in non-bleeding patient.
- HCT < 30 % and symptomatic or at risk for ischemia.
- Symptomatic chronic anemia.
- Anv HCT in life threatening active bleeding.

Prepare:

The TRANSFUSE CROSSMATCHED RBCS order has been adjusted to 2 Units. [↶ Undo](#)

Special requirements:

Save as patient's requirements?

Autologous?

2. For Platelets, there is an option for Concentrate, HLA Match, or Irradiated. This will also cross encounters if **Save as patient's Requirements** is selected.

The screenshot shows the 'ORDER PLATELETS' interface. At the top, there are buttons for 'Accept', 'Cancel', and 'Remove'. Below this, the 'Reference' is '1. Test Information'. The 'Priority' is set to 'Routine'. The 'Process Inst.' is 'ALL PLATELETS FOR ADU'. The 'INDICATIONS FOR ADUL' section lists three criteria: '1. Platelet count < 10,000', '2. Platelet count < 50,000', and '3. Platelet count < 100,000 bleeding.'. The 'Prepare:' section shows a red warning icon, a 'Units' field with '1 U', and a 'Special requirements:' field with a search icon. A 'Category Select' dialog box is open in the foreground, displaying a search bar and a list of categories: 'Concentrate', 'HLA Match', and 'Irradiated'. The 'Concentrate' option is selected. At the bottom of the dialog, it says '3 categories loaded.' and has 'Accept' and 'Cancel' buttons. The main interface also has an 'And' button and a 'TRANSFUSE PLATELETS' button at the bottom left.